


FACTORY WIRED FACTORY INSTALLED  
(FIELD INSTALLED SERIES 11 ONLY)

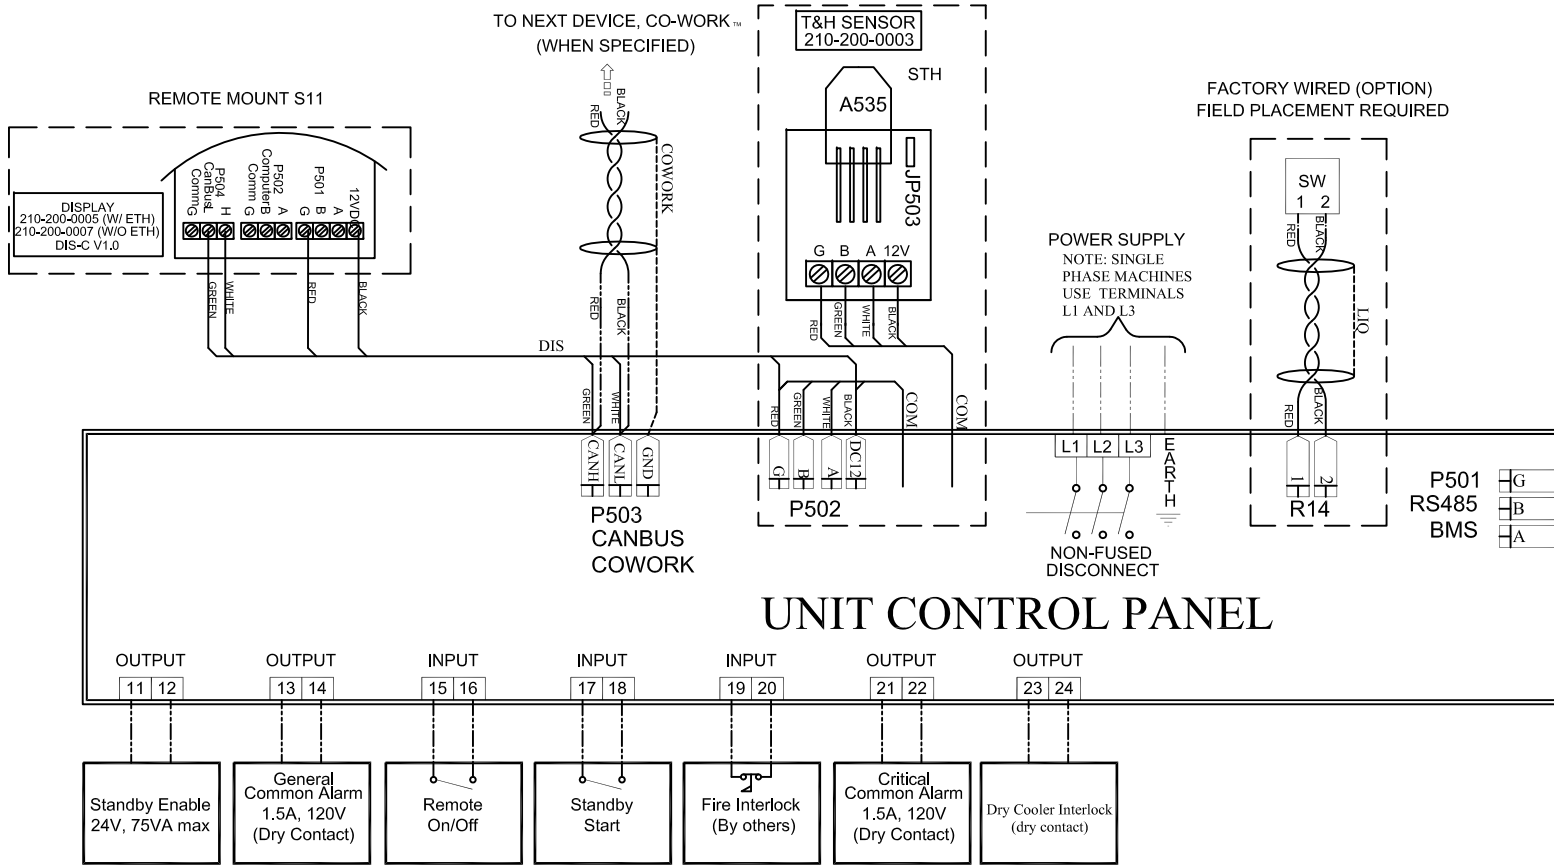

RS 485 Communication  
 for use with Modbus RTU  
 Monitoring and Control System.

**LEGEND**

- TERMINALS ON PCB
- STH TEMPERATURE & HUMIDITY SENSOR
- SW WATER DETECTOR (OPTION)
- CONNECTION TERMINAL
- FACTORY WIRING
- - - - - FIELD SUPPLIED WIRING

**INTERFACE OPTIONS**

INPUTS		
No.	DESCRIPTION	
31-32	COMPRESSOR DISABLE	
35-36	REMOTE ON/OFF INTERRUPT	
39-40	CUSTOM FAULT No. 1	
41-42	CUSTOM FAULT No. 2	
43-44	LIQUID HIGH LIMIT (STANDARD ON SERIES 11)	
57-58	DAMPER END SWITCH	
49-50	REHEAT/ HUMIDIFIER DISABLE	
OUTPUTS		
No.	DESCRIPTION	
25-26	PUMP INTERLOCK	
37-38	UNIT STATUS	
59-60	DAMPER INTERLOCK	